

**INSTALLATION DETAILS**  
**ELC6375DXD LOUVER**  
**MIAMI-DADE COUNTY & FLORIDA PRODUCT APPROVED**

**ELC6375DXD LOUVER**  
**INSTALLATION DETAIL**  
**JAMB SIMILAR**


**NOTES:**

1. The installation shown herein must be followed strictly to ensure compliance with Miami-Dade and Florida Approvals.
2. Aluminum clip angles and #10 screws shown above are provided by Ruskin. Anchors for connection to structure are not provided by Ruskin.
3. Reference detail callout for quantity of anchor required per clip angle.
4. Reference Anchor Requirements Schedule for anchor information. Anchors are not provided by Ruskin.
5. Ruskin is not responsible for determining the suitability of the structure, or for gaining approval for non-compliant installations.
6. Shims may be required to achieve consistent clearance between louver and opening on all sides. Shims are not provided by Ruskin.
7. Backer rod and sealant are not provided by Ruskin.
8. Louvers may be provided with factory installed rear mullion supports that may add up to 5 1/8" (130) additional depth to louver. Reference spec sheet for more information.
9. NIRC = Not in Ruskin's Contract.

Dimensions in inches, parenthesis ( ) indicate millimeters.

**ANCHOR REQUIREMENTS**  
 (Anchors not provided by Ruskin)

Structure Material	Fastener Specification
Timber	3/8" (10) diameter, 2" (51) long lag screw, 2" (51) min. edge distance
Steel	3/8" (10) self tapping screw or bolt. Minimum metal thickness is 16 ga.
Concrete	3/8" (10) Hilti HLC sleeve anchors, 3" (76) min. edge distance, 1 1/4" (31) minimum embedment. 2000 psi min. concrete.

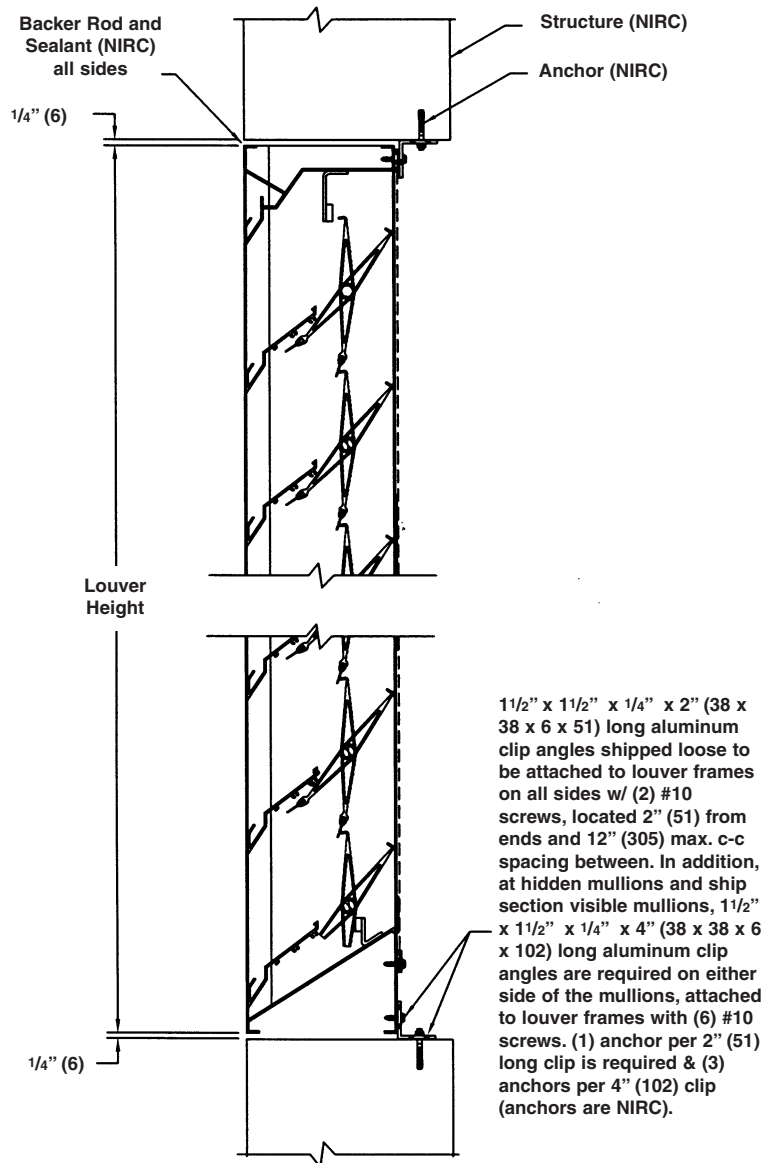

**RUSKIN**<sup>®</sup>

3900 Dr. Greaves Rd.  
Kansas City, MO 64030  
(816) 761-7476  
FAX (816) 765-8955  
[www.ruskin.com](http://www.ruskin.com)

Printed on recycled paper  
using vegetable based inks

