



Technical Data		FSTF120 RUS
Power supply	nominal	120 VAC, 60 Hz
	tolerance	108 to 132 VAC, 60 Hz
Power consumption	running	2 W, 3.5 VA
	holding	1.5 W, 2.5 VA
	max. inrush current	2.1A
Electrical connection		3 ft, 18 GA appliance cable (-S models have 2 cables)
Overload protection		1/2" conduit connector
Overload protection		electronic throughout 0 to 95° rotation
Electrical protection		actuators are double insulated
Angle of rotation		max 95°, adjust. with mechanical stop
Torque		min. 18 in-lb [2 Nm]
Direction of rotation		reversible with cw/ccw mounting
Position indication		visual indicator, 0° to 95° (0° spring return position)
Running time	motor	< 75 sec (0 to 18 in-lb)
	spring	< 25 sec @32°F to 122°F [0°C to 50°C]
Humidity		5 to 95% RH non-condensing
Ambient temperature		32°F to 122°F [0°C to 50°C]
Operating temperature		Up to 250°F for 1/2 hour per UL555S test
Housing		NEMA type 2 / IP42, UL enclosure type 2
Housing material		UL94-5VA, UL2043 Listed for plenum use
Agency listings†		cULus acc. to UL60730-1A/-2-14, CAN/CSA E60730-1:02), UL2043 smoke rated
Noise level (max)	running	< 50 db (A)
	spring return	62 dB (A)
	holding	inaudible
Servicing		maintenance free
Quality standard		ISO 9001
Weight		1.26 lbs (0.57 kg)

† Rated Impulse Voltage 4kV, Type of action 1.AA, Control Pollution Degree 3.

### Torque min. 18 in-lb, for control of fire and smoke dampers

### Application

The type FSTF RUS spring-return actuator is intended for the operation of smoke and combination fire and smoke dampers in ventilation and air-conditioning systems. The actuator will meet requirements of UL555 and UL555S when tested as an assembly with the damper Square footage of damper operated will depend on make and model.

### Operation


Mounting of the actuator to the damper axle shaft or jackshaft is via a cold-weld clamp. Teeth in the clamp and V-bolt dig into the metal of both solid and hollow shafts maintaining a perfect connection. The specially designed clamp will not crush hollow shafts. The bottom end of the actuator is held by an anti-rotation strap or by a stud provided by the damper manufacturer.

The actuator is mounted in its fail safe position with the damper blade(s) typically closed. Upon applying power, the actuator drives the damper to the open position. The internal spring is tensioned at the same time. If the power supply is interrupted, the spring moves the damper back to its fail-safe position.

### SAFETY NOTE

Screw a conduit fitting into the actuator's bushing. Jacket the actuator's input and output wiring with suitable flexible conduit. Properly terminate the conduit in a suitable junction box.

### Dimensions (Inches [mm])

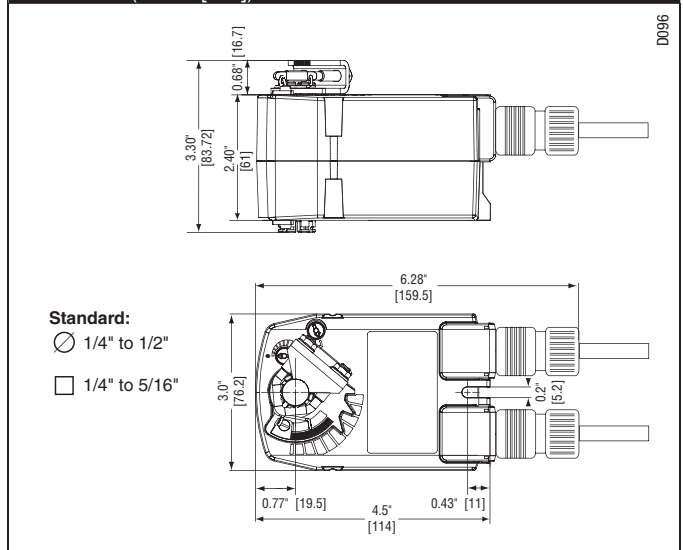

# FSTF120(-S) US

On/Off, Spring Return, 120 VAC



## Accessories

Tool-06	8mm and 10 mm wrench
KH-TF	Crank arm for up to 1/2" round shaft
ZG-TF2	Crank arm adaptor kit for FSTF
ZG-TF112	Mounting bracket, kit for FSTF
ZS-100	Weather shield (metal)
ZS-150	Weather shield (polycarbonate)
10379-00001	Limit stop

**NOTE:** When using FSTF120 RUS actuators, only use accessories listed on this page or those provided by damper manufacturers.


For actuator wiring information and diagrams, refer to Belimo Wiring Guide.

## Typical Specification


On/Off fire and smoke spring return damper actuators shall be direct coupled type which require no crank arm and linkage and be capable of direct mounting to a shaft up to a 1/2" diameter and center a 1/2" shaft. The actuators must be designed so that they may be used for either clockwise or counterclockwise fail-safe operation. Actuators shall be protected from overload at all angles of rotation. If required, two SPDT auxiliary switches shall be provided. Actuators shall be cULus listed and have a 5 year warranty, and be manufactured under ISO 9001 International Quality Control Standards. Actuators shall be as manufactured by Belimo.


## Wiring Diagrams

### **INSTALLATION NOTES**

 **CAUTION Equipment Damage!**  
Actuators may be connected in parallel.  
Power consumption must be observed.

### **APPLICATION NOTES**

 Meets cULus requirements without the need of an electrical ground connection.

 **WARNING Live Electrical Components!**  
During installation, testing, servicing and troubleshooting of this product, it may be necessary to work with live electrical components. Have a qualified licensed electrician or other individual who has been properly trained in handling live electrical components perform these tasks. Failure to follow all electrical safety precautions when exposed to live electrical components could result in death or serious injury.

