

SD60

Galvanized | Airfoil Blade Smoke Damper
UL555S Leakage Class I Classified



APPLICATION

The SD60 is an ultra low leakage rated smoke damper used in ducts that penetrate smoke rated barriers. The high strength one-piece airfoil blades insure lowest resistance to airflow with velocities up to 4000 fpm (20.3 m/s) and 8 in w.g. (2 kPa). The SD60 may be installed vertically (with blades running horizontal) or horizontally and is rated for airflow and leakage in either direction.

STANDARD CONSTRUCTION

| | |
|-------------|---|
| Frame | 5" x 16 gauge (127 x 1.6) galvanized, single piece, hat-shaped channel frame |
| Blades | One-piece airfoil, nominal 6" (152) wide and 14 (2.0) gauge galvanized steel equivalent strength. Blades are approximately 6" (152) on center |
| Bearings | Stainless steel sleeve type, pressed into frame |
| Jamb Seals | Stainless steel, flexible metal compression type |
| Blade Seals | Silicone edge type for smoke seal to 450°F (232°C) mechanically fastened to the blade edge |
| Linkage | Concealed in frame |

OPERATION OPTIONS

| | |
|---------------|----------------|
| Fail Position | Closed or Open |
|---------------|----------------|

DAMPER SIZES

Sizes listed below are for ratings of 2000 fpm (10.2 m/s) and 4 in. wg (1 kPa). See page 3 for extended operational ratings.

| | |
|--------------|---|
| Minimum size | 8" w x 6" h (203 x 152) |
| Maximum size | Single Section 48" w x 72" h (1219 x 1829) |
| | Multiple Section 144" w x 96" h (3658 x 2438), 288" w x 48" h (7315 x 1219) or 72" w x 192" h (1829 x 4877) |

*Multiple section assemblies consist of 36" x 48" (914 x 1219) max single section sizes.

MAXIMUM OPERATIONAL RATINGS

| | |
|-----------------------|---------------------|
| UL555S Leakage Rating | Class I |
| Maximum Velocity | 4000 FPM (20.3 m/s) |
| Maximum Pressure | 8 in. wg (2kPa) |
| Temperature | 350°F (177°C) |



Model SD60 meets the requirements for smoke dampers established by:

- ▶ National Fire Protection Association NFPA Standards 80, 90A, 92A, 92B, 101 and 105
- ▶ ICC International Building Codes
- ▶ CSFM California State Fire Marshal Listing (#3230-0245:0131)
- ▶ New York City (MEA 252-05-E)

OPTIONS & ACCESSORIES

ADC105 Addressable Damper Controller for remote testing with Simplex ES fire alarm panels

MCP control panels for test purposes or smoke management systems

DTS-SD (Damper Test Switch) test switch for cycle testing

SP100 Switch Package to allow remote indication damper or damper blade position

Factory Sleeves of various lengths and gauges to ensure field compliance with UL installation requirements

DSDF/DSDN Smoke Detector (Flow rated or No-Flow)



SEE COMPLETE MARKING ON PRODUCT

UL555S Classification R5531

NOTE:


1. Dampers furnished approximately 1/4" (6) smaller than given opening dimensions.
2. Dimensions shown in () indicate millimeters.

AMCA LICENSED AIR PERFORMANCE DATA

Pressure Drop Data SD60 air performance testing is performed in accordance with AMCA Standard 500-D configuration 5.3 as illustrated below. All data are corrected to standard air density of .075 lb/ft³ (1.201 kg/m³).



Ruskin Company certifies that the SD60 shown hereon is licensed to bear the AMCA Seal. The ratings shown are based on tests and procedures performed in accordance with AMCA Publication 511 and comply with the requirements of the AMCA Certified Ratings Program. The AMCA Certified Ratings Seal applies to air performance for the SD60.

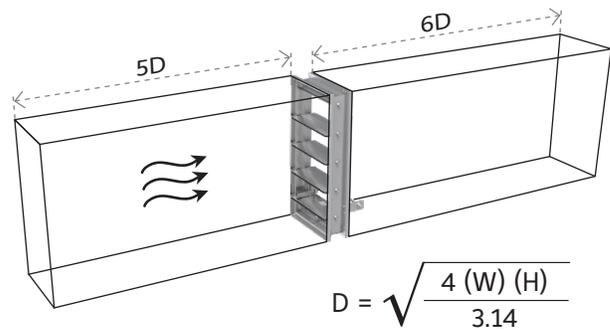


AMCA Figure 5.3 was established to represent a fully ducted damper with straight duct upstream and downstream. With entrance and exit losses minimized by this straight duct arrangement, this configuration has the lowest pressure drop of all three configurations.

To determine the AMCA Licensed air performance:

Locate the applicable feet per minute face velocity on the bottom of the velocity vs. pressure drop chart below. Move up the chart to the most appropriate size damper line. From the intersection point, move left to determine the pressure drop on the left side of the chart.

For other damper sizes refer to **Air Performance Data For All Smoke Dampers** spec sheet.

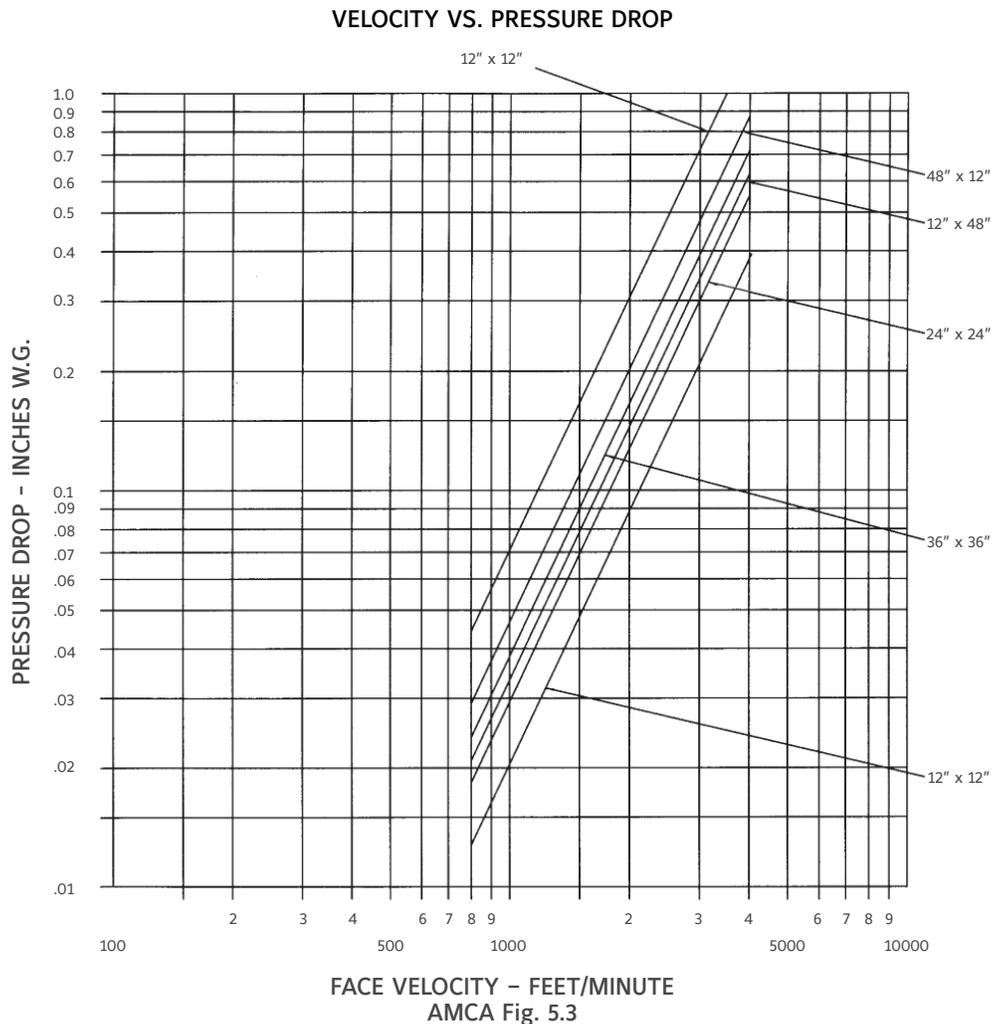

EXTENDED OPERATIONAL RATINGS

The UL555S Test Standard requires all smoke dampers to prove their operation (Close to Open and Open to Close) against heated air flow with minimum temperature of 250°F (121°C), minimum velocity of 2,000 feet per minute (10.2 m/s) and minimum static pressure of 4 inches of water (1 kPa). UL555S extended ratings allow the temperature to be increased at 100°F (37.8°C), 2 inches of water (0.5 kPa) and 1000 feet per minute (5.1 m/s) increments. The SD60 smoke damper exceeds the minimum UL555S requirements on selected sizes. See chart for sizes and ratings. **Consult Ruskin for the appropriate actuator model and quantities.**


EXTENDED RATINGS FOR FAIL CLOSE

| Size | Static Pressure | Temperature |
|--|----------------------------|---------------|
| 2,000 FPM (10.2 m/s) | | |
| 144" x 96" (3658 x 2438) 288" x 48" (7315 x 1219) 72" x 192" (1829 x 4877) | 4" (102) w.g. (1 kPa) | 350°F (177°C) |
| 180" x 64" (4572 x 1625) 360" x 32" (9144 x 813) 90" x 128" (2286 x 3251) | 6" (152) w.g. (1.5 kPa) | 250°F (121°C) |
| 48" x 48" (1219 x 1219) 96" x 24" (2438 x 610) 24" x 96" (610 x 2438) | 8" (203) w.g. (2 kPa) | 250°F (121°C) |
| 3,000 FPM (15.2 m/s) | | |
| 64" x 72" (1625 x 1829) 128" x 36" (3251 x 914) | 4" (102) w.g. (1 kPa) | 250°F (121°C) |
| 64" x 64" (1625 x 1625) 128" x 32" (3251 x 813) | 4" (102) w.g. (1 kPa) | 350°F (177°C) |
| 180" x 64" (4572 x 1625) 360" x 32" (9144 x 813) 90" x 128" (2286 x 3251) | 6" (152) w.g. (1.5 kPa) | 250°F (121°C) |
| 48" x 48" (1219 x 1219) 96" x 24" (2438 x 610) 24" x 96" (610 x 2438) | 8" (203) w.g. (2 kPa) | 250°F (121°C) |
| 4,000 FPM (20.3 m/s) | | |
| 48" x 48" (1219 x 1219) 96" x 24" (2438 x 610) 24" x 96" (610 x 2438) | 8" (203) w.g. (2 kPa) | 250°F (121°C) |


EXTENDED RATINGS FOR FAIL OPEN

| Size | Static Pressure | Temperature |
|--|--------------------------|---------------|
| 2,000 FPM (10.2 m/s) Fail Open Operation | | |
| 72" x 96" (1829 x 2438) 144" x 48" (3658 x 1219) 36" x 192" (914 x 4877) | 4" (102) w.g. (1 kPa) | 250°F (121°C) |
| 3,000 FPM (15.2 m/s) | | |
| 72" x 64" (1892 x 1625) 144" x 32" (3658 x 813) 36" x 128" (914 x 3251) | 4" (102) w.g. (1 kPa) | 250°F (121°C) |
| 4,000 FPM (20.3 m/s) | | |
| 48" x 48" (1219 x 1219) 96" x 24" (2438 x 610) 24" x 96" (610 x 2438) | 8" (203) w.g. (2 kPa) | 250°F (121°C) |


TYPICAL ACTUATOR MOUNTING

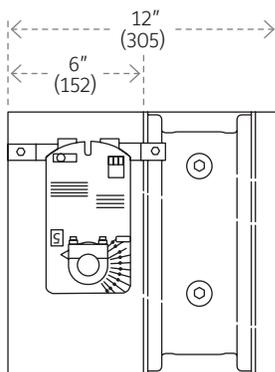

Multiple Section with Side Plate

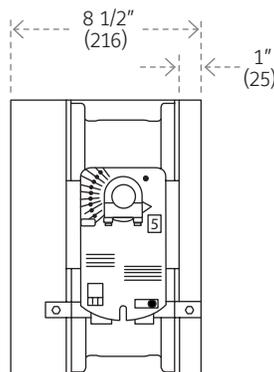

Single Section with Side Plate

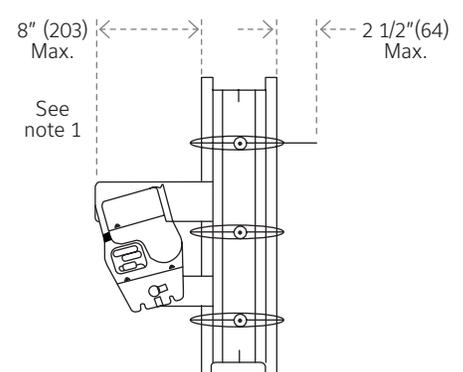

Typical Internal Mount

NOTE:

1. 8" (203) actuator depth shown varies upon the damper height and actuator selection.
2. External mount actuators may extend above or below the damper height.

ACTUATOR REQUIREMENTS

- ▶ UL555S requires that all smoke dampers have factory mounted actuators in order to bear the UL label.
- ▶ Smoke dampers larger than single section may require multiple actuators. See "Smoke Damper Multiple Section Detail" spec sheet for details.
- ▶ Ruskin's smoke dampers are UL555S labeled with either electric or pneumatic actuators mounted internal (in air stream) or external (out of air stream).
- ▶ Smoke dampers utilizing multiple actuators must have all actuators field wired to a common point for simultaneous closure. All field wiring shall be in accordance with applicable codes, ordinances and regulations.

SLEEVE TRANSITION DIMENSIONAL INFORMATION

DUCT TRANSITION CONNECTIONS

SD60 dampers may be supplied with Round, Oval and Rectangular duct connections.

| Style | Description |
|-------|--|
| CR | Round Sealed (Medium Pressure) |
| WR | Round Welded (High Pressure) |
| C | Rectangular Sealed (Low and Medium Pressure) |
| WC | Rectangular Welded (High Pressure) |
| CO | Oval Sealed (Medium Pressure) |
| WO | Oval Welded (High Pressure) |

The square damper size will be 2" (51) larger in width and height than the round, oval or rectangular duct size ordered.

MINIMUM and MAXIMUM SIZES

Round Transitions

Minimum – 4" (102) diameter
Maximum – 94" (2388) diameter






Rectangular and Oval Transitions

Minimum – 6" w x 4" h (152 x 102)
Maximum – 142" x 94" (3607 x 2388)

Consult Ruskin for other available styles and sizes.


Note:

For medium pressure units (Styles CR, C and CO) the collar extends 1 1/2" (38) beyond the sleeve length and for low pressure and high pressure units (Styles R, WR, WC and LO) the collar extends 2 1/2" (64) beyond the sleeve length.

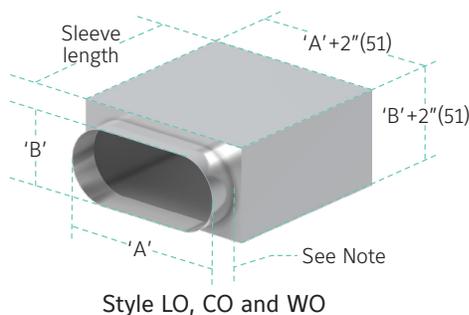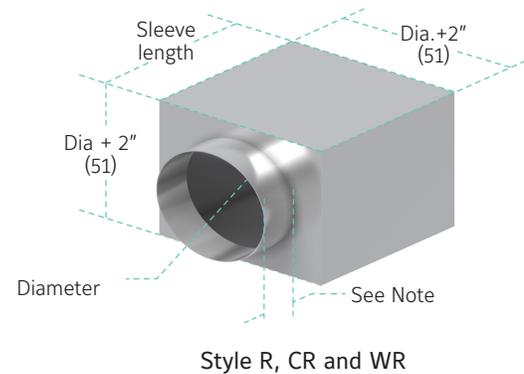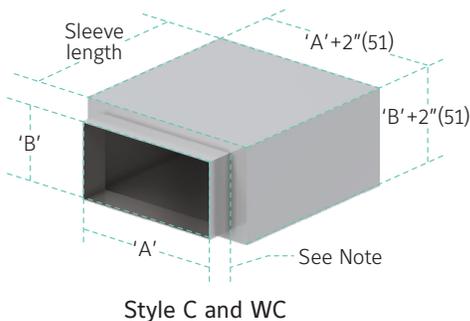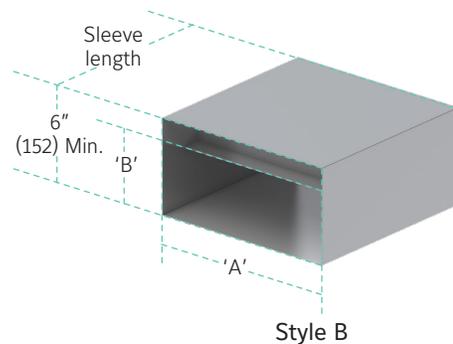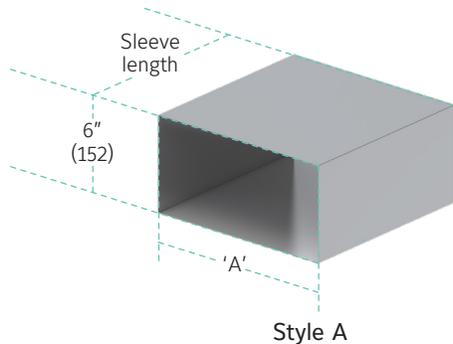

DAMPER LEAKAGE TO ATMOSPHERE

When Ruskin's Smoke Dampers are supplied with a factory installed damper sleeve, the sealed sleeve meets the lowest duct leakage requirements set fourth by SMACNA. See Details Below

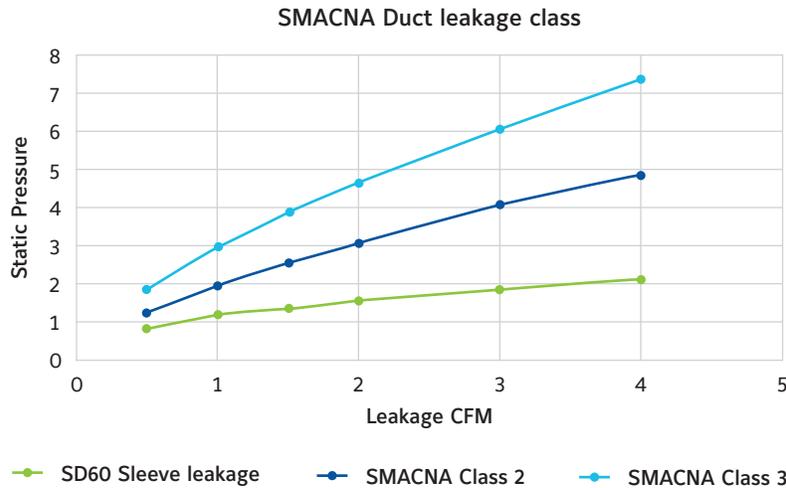

SUGGESTED SPECIFICATION

Smoke dampers meeting or exceeding the following specifications shall be furnished and installed at locations shown on plans or as described in schedules. AMCA Certified smoke dampers shall meet the requirements of NFPA80, 90A, 92A, 92B, 101 and 105 and shall be classified as Smoke Dampers in accordance with the latest version of UL555S. The leakage rating under UL555S shall be Leakage Class 1. Smoke dampers shall be produced in an ISO 9001 certified factory and warranted to be free from defects in material and workmanship for a period of 5 years after date of shipment.

Damper frame, where size permits, shall be constructed using the UniFrame Design Concept (UDC) and shall be minimum 16 (1.6) gauge galvanized steel formed into a structural hat channel. Top and bottom frame members on dampers less than 13" (330) high shall be low profile design to maximize the free area of these smaller dampers. Damper blades shall be single piece airfoil shaped with 14 (2.0) gauge equivalent strength. Airfoil type blades generate low pressure drop and low noise levels. Blade edge seals shall be inflatable silicone mechanically locked into blade edge. Jamb seals shall be stainless steel compression type. Bearings shall be stainless steel, permanently lubricated sleeve type turning in an extruded hole in the frame for maximum life.

Smoke dampers and their actuators shall be qualified in accordance with UL555S to an elevated temperature of 250°F (121°C) or 350°F (177°C) depending upon the actuator. Appropriate electric or pneumatic actuators (**specifier select one**) shall be installed by the damper manufacturer at time of damper fabrication. Electric actuators, factory installed on dampers, shall have been tested for prolonged periods of holding (minimum 1 year with no evidence of reduced spring return performance). Each damper shall be rated for leakage and airflow in either direction through the damper. In addition to the leakage ratings already specified, the dampers shall be AMCA licensed for Air Performance.

Smoke dampers shall be Ruskin model SD60.

(Consult www.Ruskin.com for electronic version of this "Quick" spec as well as for complete 3-part CSI *MasterFormat* Specification).

i LINKS TO IMPORTANT DOCUMENTS

| Document Number | Document Title |
|------------------|--|
| II-SD-118 | Smoke Damper Installation |
| FSD O-and-M_0120 | Operation and Maintenance Instructions |
| FSD60-MSD-319 | FSD/SD Multiple Section Details |



3900 Doctor Greaves Road
Kansas City, MO 64030
Website: www.ruskin.com
Phone: (816) 761-7476