

## DFD60GA "OUT OF THE WALL" GRILLE ACCESS MULTIPLE BLADE FIRE DAMPER

1½ HOUR RATING UL555 RATED FOR USE IN "DYNAMIC" SYSTEMS

### APPLICATION

The DFD60GA 1½ hour dynamic rated fire dampers are designed for "out of wall" applications. The damper assembly can be installed completely from one side of the wall and does not require mounting angles on the backside. The DFD60GA dampers allow through the grille access to the damper, permits access to the damper fusible ink assembly. Dampers may be installed vertically (in walls) in HVAC systems with airflow in either direction with velocities up to 2,000 fpm and pressures to 4" w.g.

### STANDARD CONSTRUCTION

#### FRAME

5" x 1" x 16 gage (127 x 25 x 1.52) galvanized steel hat channel, structurally superior to 13 gage (2.3) channel frame.

#### BLADES

Single piece airfoil-shaped construction with 14 gage (1.90) equivalent, approximately 6" (152) on center.

#### BEARINGS

Stainless steel sleeve, pressed into frame.

#### LINKAGE

Concealed in frame.

#### AXLES

½" (13) plated steel hex.

#### FUSIBLE LINK

165°F (74°C) standard or 212°F (100°C) available.

#### DAMPER WEIGHT

Approximately 18 lbs. per sq. ft.

### DAMPER SIZES

#### MINIMUM SIZE

Vertical Installation – 8"w x 6"h (203 x 152)

#### MAXIMUM SIZE

##### Single Section

Vertical Installation – 32"w x 36"h (813 x 914)

##### Multiple Sections


Vertical Installation – 36"w x 36"h (914 x 914)

### OPTIONS

- **FM Approvals** as Specification Tested Product.
- **SP100 Switch Package** to remotely indicate damper blade position.
- **FAST Angle** for one side angle installation.
- **Sleeve** of various lengths and gages to ensure field compliance with UL installation requirements.
- **Jamb Seals** stainless steel flexible metal compression type.
- **Blade Seals** Silicone blade edge seals.
- **Crank Lever** to assist with testing and fuse link replacement.
- **OW, Out of Wall** of application where the damper can not be installed within the plane of the wall or floor.

#### Notes:

1. Dimensions in inches, parentheses ( ) indicate millimeters.
2. Damper/sleeve assembly furnished actual size.

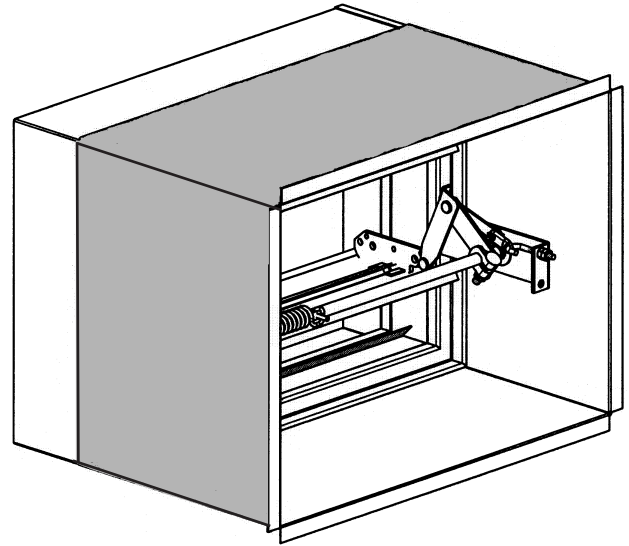

The DFD60GA dampers meet the requirements for fire dampers established by:

- **National Fire Protection Association NFPA Standards** 90A, 92A, 92B and 101
- **ICC International Building Codes**
- **CSFM California State Fire Marshal Listing #3225-245:005**




SEE COMPLETE  
MARKING  
ON PRODUCT

UL555 Classification R5531

#### FM Approvals

Specification Tested Product  
(Option)

## TYPICAL INSTALLATION

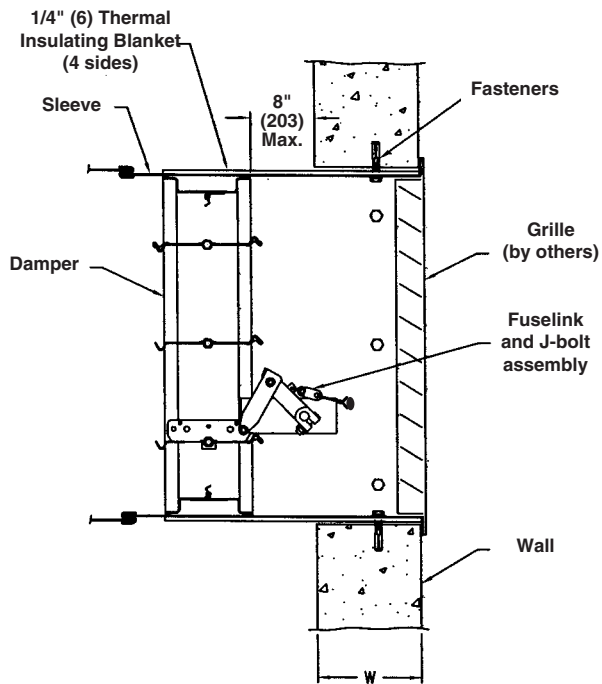

### Wall Opening

The opening in the wall shall be sized to accommodate the overall size of the damper, sleeve and insulation assembly. No expansion gap is required.

For proper installation, frame and finish the opening so it is 1/2" (13) larger in width and 1/2" (13) larger in height than the duct size.

For example a 24" w x 20"h (610 x 508) damper requires a wall opening of 24 1/2"w x 20 1/2"h (622 x 521). The damper/sleeve to duct connection remains 24"w x 20"h (610 x 508) and is the dimension used for grille considerations.

### Sleeve Length

1. Ruskin standard sleeve length is 16" (406) based on a grille depth of 2" (51) and duct connection of 1 1/2" (38).
2. Add 1" (25) to sleeve length for every 1" (25) of additional grille depth. For example, a grille depth of 4" (102) requires a minimum sleeve length of 18" (457).
3. Consult Ruskin if sleeve lengths less than 16" (406) are required.

**Note:** Damper may not be outside wall/floor more than 8" (203).

## SUGGESTED SPECIFICATION (DFD60GA)

Furnish and install at locations shown on plans or as described in schedules AMCA Certified fire dampers constructed and tested in accordance with UL Safety Standard 555 that meet or exceed the following specifications. Fire Dampers shall be produced in an ISO 9001 certified factory.

Damper frame, where size permits, shall be constructed using Uniframe Design Concept (UDC) and shall be minimum 16 gage (1.52) galvanized steel formed into a structural hat channel superior to 13 gage (2.30) channel frame. Top and bottom frame members on dampers less than 13" (330) high shall be low profile design to maximize the free area of these smaller dampers. Damper blades shall be single piece airfoil shaped with 14 gage (1.90) equivalent thickness. Airfoil type blades generate low pressure drop and low noise levels. Bearings shall be stainless steel, permanently lubricated sleeve type turning in an extruded hole in the frame for maximum life.

Each fire damper shall have a 1 1/2 hour fire protection rating and shall be supplied with a 165°F (74°C) or 212°F (100°C) fusible link. Fire dampers shall be constructed for vertical "out of the wall" installation with a supply or return duct terminating at a wall grille.

Dampers shall be installed completely from one side of the wall and shall not require retaining angles on the backside. Access to the fusible link shall be through the grille area. Submittal information shall include the fire protection, maximum velocity and pressure ratings and the manufacturer's UL installation instructions.

Each fire damper shall be labeled for use in dynamic systems. Static only damper labels are not permissible. The damper shall be rated for dynamic closure at 2000 fpm (10.2 m/s) and 4" w.g. (1 kPa) static pressure and shall be tested and rated to close with airflow in either direction. Vertical dampers installed in walls shall have extended dynamic closure and operational ratings of 4000 fpm (20.3 m/s) and 8" w.g. (2 Pa).

### Optional FM Approvals Specification

Each fire damper shall be listed in Factory Mutual (FM) Approvals Specification Tested Product and labeled accordingly.

Dynamic fire dampers shall be Ruskin model DFD60GA.

(Consult [www.ruskin.com](http://www.ruskin.com) for electronic version of this "Quick" spec as well as for complete 3-part CSI MasterFormat Specifications)

# RUSKIN®

3900 Dr. Greaves Rd.  
Kansas City, MO 64030  
(816) 761-7476  
FAX (816) 765-8955  
[www.ruskin.com](http://www.ruskin.com)

Printed on recycled paper  
using vegetable based inks

